SunLong Biotech Co.,LTD
Tel: 0086-571-56623320 Fax:0086-571-56623318
E-mail:sales@sunlongbiotech.com
www.sunlongbiotech.com

Recombinant Fibroblast Growth Factor 23 (FGF23)

Catalog Number: SIPA168Ra01 **Spec: 10ug**

Product Name	Recombinant Fibroblast Growth Factor 23 (FGF23)
Catalog Number	SIPA168Ra01
Organism Species	Rat
Source	Prokaryotic expression
Host	E.coli
Residues	Tyr25~Val251
Tags	N-terminal His Tag
Subcellular Location	Secreted
Purity	> 80%
Traits	Freeze-dried powder
Buffer formulation	PBS, pH7.4, containing 0.01% SKL, 5% Trehalose .
Original Concentration	300μg/mL
Applications	Positive Control; Immunogen; SDS-PAGE; WB. (May be suitable for use in other assays to be determined by the end user.)
Predicted isoelectric point	10.0
Predicted Molecular Mass	29.1kDa
Accurate Molecular Mass	30kDa as determined by SDS-PAGE reducing conditions.

[USAGE]

Reconstitute in 10mM PBS (pH7.4) to a concentration of 0.1-1.0 mg/mL. Do not vortex.

[STORAGE AND STABILITY]

Storage: Avoid repeated freeze/thaw cycles.

Store at 2-8ºC for one month.

Aliquot and store at -80ºC for 12 months.

Stability Test: The thermal stability is described by the loss rate. The loss rate was determined

by accelerated thermal degradation test, that is, incubate the protein at 37°C for 48h, and no obvious degradation and precipitation were observed. The loss rate is less than 5% within the expiration date under appropriate storage condition.

[SEQUENCE]

```
                          YSDTSP LLGSNWGSLT HLYTATARNS
YHLQIHRDGH VDGTPHQTIY SALMITSEDA GSVVIIGAMT RRFLCMDLRG
NIFGSYHFSP ENCRFRQWTL ENGYDVYLSP KHHYLVSLGR SKRIFQPGTN
PPPFSQFLAR RNEVPLLHFY TARPRRHTRS AEDPPERDPL NVLKPRPRAT
PIPVSCSREL PSAEEGGPAA SDPLGVLRRG RGDARRGAGG TDRCRPFPRF
V
```

[IDENTIFICATION]

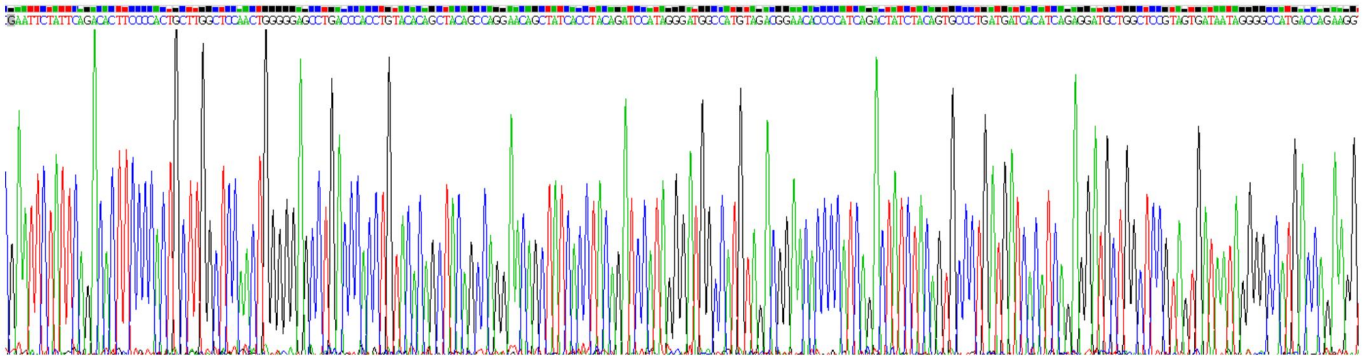


Figure . Gene Sequencing (extract)

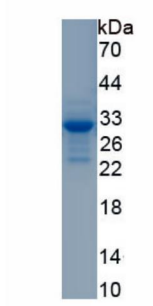


Figure. SDS-PAGE

SunLong Biotech Co.,LTD
Tel: 0086-571-56623320 Fax:0086-571-56623318
E-mail:sales@sunlongbiotech.com
www.sunlongbiotech.com

[IMPORTANT NOTE]

The kit is designed for research use only, we will not be responsible for any issue if the kit was used in clinical diagnostic or any other procedures.