SunLong Biotech Co.,LTD
Tel: 0086-571-56623320 Fax:0086-571-56623318
E-mail:sales@sunlongbiotech.com
www.sunlongbiotech.com

Recombinant Mannose Receptor C Type 1 (MRC1)

Catalog Number: SIPB142Mu01 **Spec: 50ug**

Product Name	Recombinant Mannose Receptor C Type 1 (MRC1)
Catalog Number	SIPB142Mu01
Organism Species	Mouse
Source	Prokaryotic expression
Host	E.coli
Residues	Leu225~Ser492
Tags	N-terminal His Tag
Subcellular Location	Exosome
Purity	> 80%
Traits	Freeze-dried powder
Buffer formulation	PBS, pH7.4, containing 0.01% Sarcosyl, 5% Trehalose.
Original Concentration	50μg/mL
Applications	Positive Control; Immunogen; SDS-PAGE; WB. (May be suitable for use in other assays to be determined by the end user.)
Predicted isoelectric point	6.9
Predicted Molecular Mass	33.9kDa
Accurate Molecular Mass	34kDa as determined by SDS-PAGE reducing conditions.

[USAGE]

Reconstitute in ddH2O to a concentration of 0.1-0.2 mg/mL. Do not vortex.

[STORAGE AND STABILITY]

Storage: Avoid repeated freeze/thaw cycles.

Store at 2-8ºC for one month.

Aliquot and store at -80ºC for 12 months.

Stability Test: The thermal stability is described by the loss rate. The loss rate was determined

by accelerated thermal degradation test, that is, incubate the protein at 37°C for 48h, and no obvious degradation and precipitation were observed. The loss rate is less than 5% within the expiration date under appropriate storage condition.

[SEQUENCE]

```
                              LTGILY QINSKSALTW HQARASCKQQ
NADLLSVTEI HEQMYLTGLT SSLSSGLWIG LNSLSVRSGW QWAGGSPFRY
LNWLPGSPSS EPGKSCVSLN PGKNAKWENL ECVQKLGYIC KKGNNTLNPF
IIPSASDVPT GCPNQWWPYA GHCYRIHREE KKIQKYALQA CRKEGGDLAS
IHSIEEFDFI FSQLGYEPND ELWIGLNDIK IQMYFEWSDG TPVTFTKWLP
GEPSHENNRQ EDCVVMKGKD GYWADRACEQ PLGYICKMVS QS
```

[IDENTIFICATION]

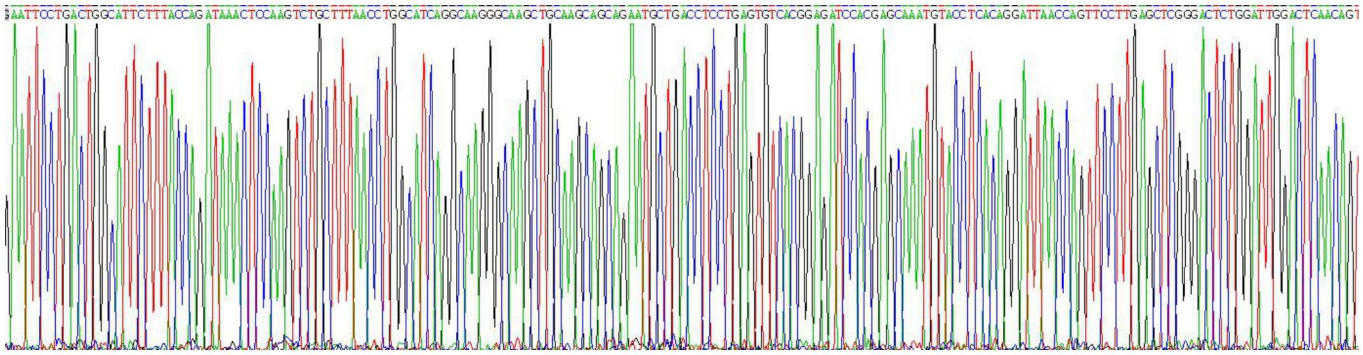


Figure . Gene Sequencing (extract)




Figure. SDS-PAGE

SunLong Biotech Co.,LTD
Tel: 0086-571-56623320 Fax:0086-571-56623318
E-mail:sales@sunlongbiotech.com
www.sunlongbiotech.com

[IMPORTANT NOTE]

The kit is designed for research use only, we will not be responsible for any issue if the kit was used in clinical diagnostic or any other procedures.